


**BASIN ASSEMBLY TOP VIEW**

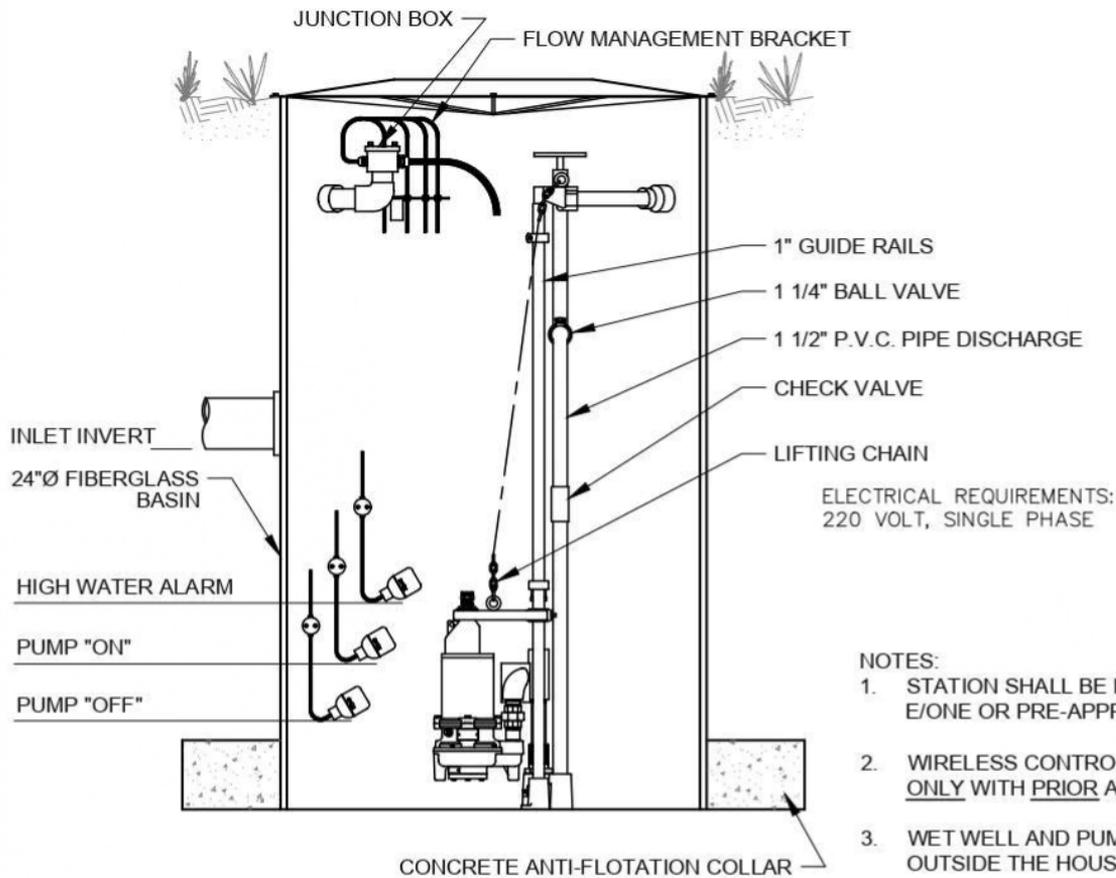

**BASIN ASSEMBLY SIDE VIEW**

**PRESSURE SEWER GRINDER  
PUMP STATION DETAIL**

NOT TO SCALE

ELECTRICAL REQUIREMENTS:  
220 VOLT, SINGLE PHASE

**NOTES:**

1. STATION SHALL BE MANUFACTURED BY E/ONE OR PRE-APPROVED EQUAL.
2. WIRELESS CONTROLS MAY BE UTILIZED ONLY WITH PRIOR AUTHORITY APPROVAL.
3. WET WELL AND PUMP MUST BE INSTALLED OUTSIDE THE HOUSE.
4. INSTALL ELECTRIC DISCONNECT ON OUTSIDE OF HOUSE.

REVISED 5/13/2025



**PENNONI ASSOCIATES INC.**  
150 Ridge Road, Suite 2  
Sellersville, PA 18960  
T 215-257-5711 F 215-257-5766

**PRESSURE SEWER GRINDER PUMP STATION**  
PREPARED FOR:  
**PERKASIE REGIONAL AUTHORITY**

DESIGNED BY:	JAR
CHECKED BY:	SRT
DATE:	4/09/97
DRAWING NO.	PRA-S016