

BASEMENT SERVICE

THROUGH FLOOR SERVICE

GENERAL NOTES:


1. NOTIFY AUTHORITY AT 215-257-3654 WHEN WATER SERVICE IS READY FOR INSPECTION AND TESTING. DO NOT BACKFILL ANY PORTION OF TRENCH PRIOR TO APPROVAL. 24 HOURS NOTICE REQUIRED.
2. WATER AUTHORITY WILL SUPPLY 5/8"x5/8" SR BRONZE REMOTE TYPE METER AND REMOTE METER READING.
3. PRESSURE REDUCING VALVE IS REQUIRED WHERE PRESSURE IS GREATER THAN 65 PSI.
OWNER/DEVELOPER SHALL PROVIDE THE PRESSURE REDUCING VALVE.
4. METER LOCATION MUST BE APPROVED BY THE AUTHORITY.
5. ALL SERVICE LINES ARE TO BE K-TYPE TUBING ONLY WITH NO SWEAT JOINTS OR COUPLINGS UNDERGROUND.
- *6. WATTS NUMBER 007 (LEAD FREE) BACKFLOW PREVENTOR SHALL BE PROVIDED BY THE OWNER/DEVELOPER WHEN REQUIRED BY PRA.

****7. PRESSURE REDUCER VALVE TO BE WATTS UB5 - LEAD FREE**

REVISÉ 10/22/15

REVISÉ 7/4/12

REVISÉ 4/30/08

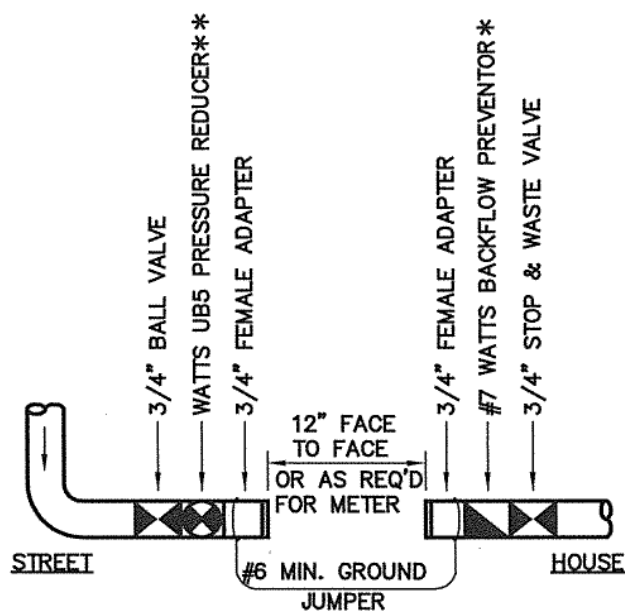

FRONT VIEW OF SETTING

RESIDENTIAL METER SETTING REQUIREMENTS

NOT TO SCALE

RESIDENTIAL METER SETTING REQUIREMENTS

PREPARED FOR:

PERKASIE REGIONAL AUTHORITY



ANDERSEN

ENGINEERING

ASSOCIATES

INCORPORATED

306 NORTH FIFTH STREET, PERKASIE, PA

(215) 257-5711

DSN BY: P.C.A.

CHK BY: P.C.A

DATE: 4/08/96

DWG NO. PRA-W10