



BASEMENT SERVICE

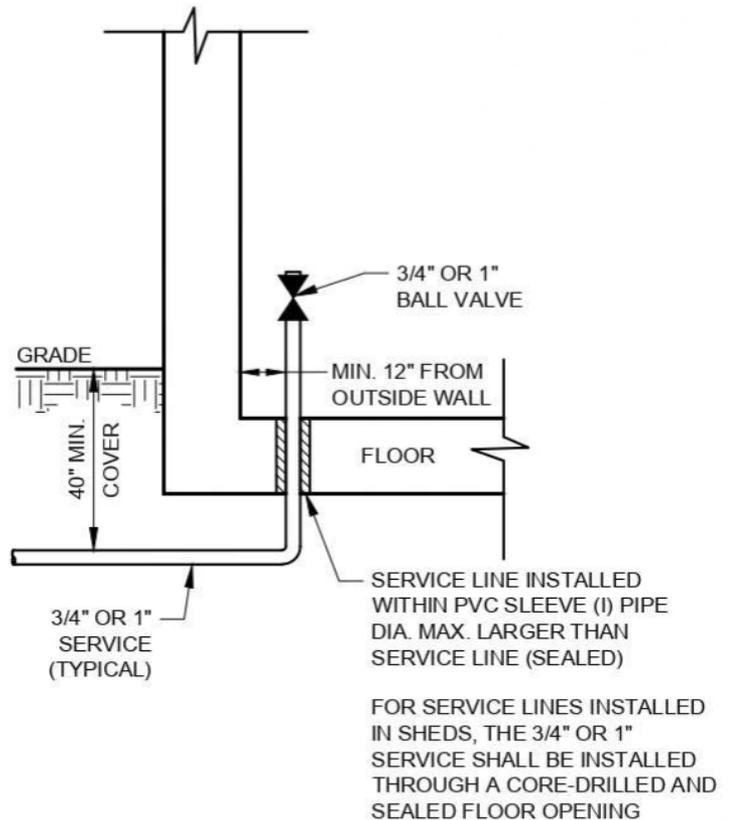

THROUGH FLOOR SERVICE

GENERAL NOTES:

1. NOTIFY AUTHORITY AT 215-257-3654 WHEN WATER SERVICE IS READY FOR INSPECTION AND TESTING. DO NOT BACKFILL ANY PORTION OF TRENCH PRIOR TO APPROVAL. 24 HOURS NOTICE REQUIRED.
2. WATER AUTHORITY WILL SUPPLY 5/8"x5/8" SR BRONZE REMOTE TYPE METER AND REMOTE METER READING.
3. PRESSURE REDUCING VALVE IS REQUIRED WHERE PRESSURE IS GREATER THAN 65 PSI. OWNER/DEVELOPER SHALL PROVIDE THE PRESSURE REDUCING VALVE.
4. METER LOCATION MUST BE APPROVED BY THE AUTHORITY.
5. ALL SERVICE LINES ARE TO BE SDR-9 ASTM 2737 POLYTUBING WITH NO SWEAT JOINTS OR COUPLINGS UNDERGROUND.
- *6. WATTS NUMBER 007 (LEAD FREE) BACKFLOW PREVENTER SHALL BE PROVIDED BY THE OWNER/ DEVELOPER WHEN REQUIRED BY PRA.
- **7. PRESSURE REDUCER VALVE TO BE WATTS UB5 - LEAD FREE

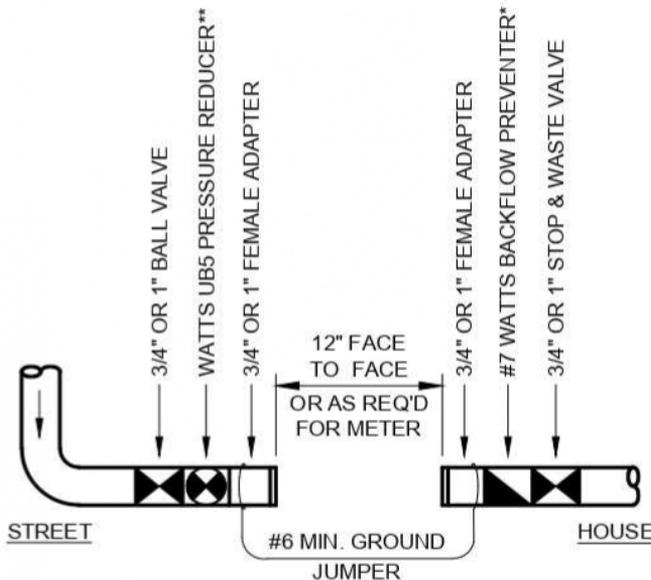

FRONT VIEW OF SETTING

RESIDENTIAL METER SETTING REQUIREMENTS

NOT TO SCALE

REVISED 7/30/2025



PENNONI ASSOCIATES INC.
150 Ridge Road, Suite 2
Sellersville, PA 18960
T 215-257-5711 F 215-257-5766

RESIDENTIAL METER SETTING REQUIREMENTS
PREPARED FOR:
PERKASIE REGIONAL AUTHORITY

| | |
|--------------|---------|
| DESIGNED BY: | JAR |
| CHECKED BY: | SRT |
| DATE: | 4/08/96 |
| DRAWING NO. | PRA-W10 |