


NOTE:
 VALVE AND VALVE
 BOXES TO BE SET
 ON 4" 2A MODIFIED
 AND BACKFILL AT
 LEAST 4" ABOVE
 TOP OF WATER MAIN

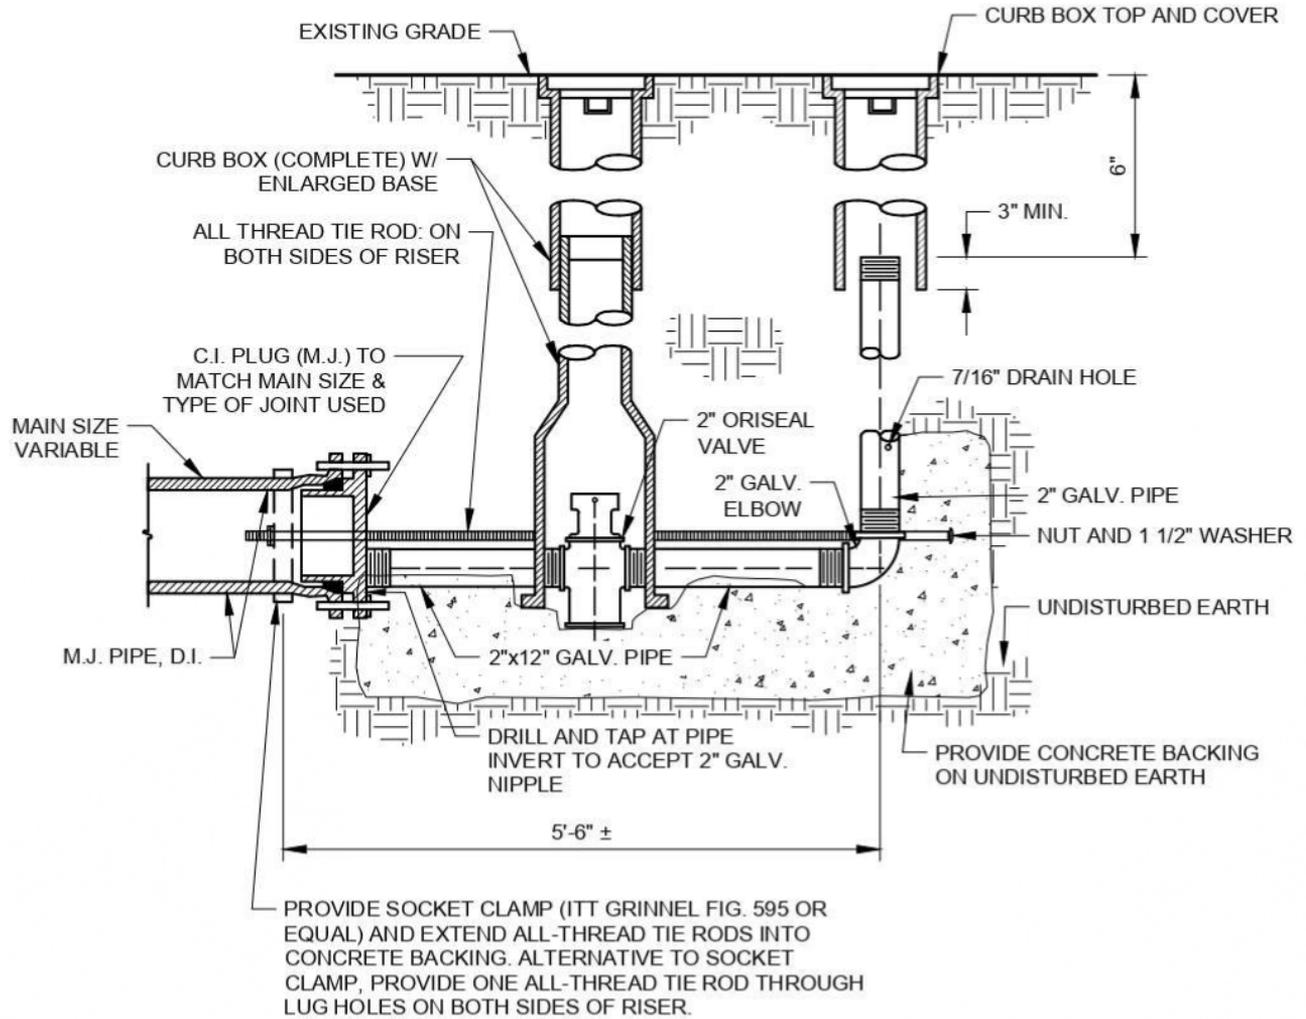

STANDARD BLOW-OFF DETAIL

NOT TO SCALE

REVISED 5/13/2025



PENNONI ASSOCIATES INC.
 150 Ridge Road, Suite 2
 Sellersville, PA 18960
 T 215-257-5711 F 215-257-5766

STANDARD BLOW-OFF
 PREPARED FOR:
PERKASIE REGIONAL AUTHORITY

| | |
|--------------|---------|
| DESIGNED BY: | JAR |
| CHECKED BY: | SRT |
| DATE: | 4/04/96 |
| DRAWING NO. | PRA-W02 |