


NOTES :

1. WET TAPPING UNDER NORMAL LINE PRESSURE IS REQUIRED.
2. CORPORATION STOPS: MULLER B-25008, OR McDONALD 4701B-22, OR EQUAL.
3. CURB STOPS: MULLER B-25209, OR McDONALD 6100-22, OR EQUAL.
4. CURB BOX: MUELLER H-10306, OR McDONALD 5604, OR FORD EA2-45-50, OR EQUAL.
5. LID WITH CENTER, REMOVABLE, PENTAGONAL PLUG: MUELLER 89375, OR McDONALD 5614L
6. CORPORATION STOP AND CURB STOP TO HAVE COMPRESSION FITTINGS.
FLARE FITTINGS NOT PERMITTED.

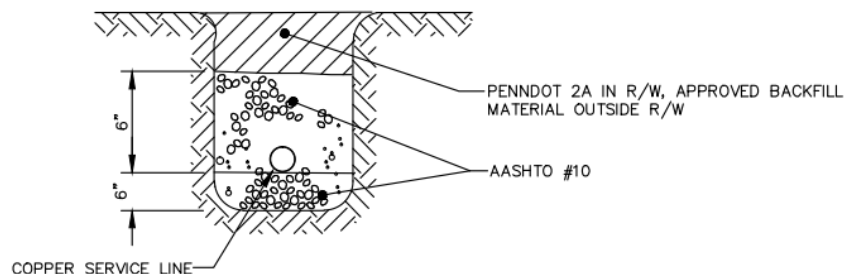

TYPICAL RESIDENTIAL SERVICE LINE CONNECTION

NOT TO SCALE

REVISED 7/4/12

RESIDENTIAL SERVICE LINE

PREPARED FOR:

PERKASIE REGIONAL AUTHORITY

ANDERSEN
ENGINEERING
ASSOCIATES
INCORPORATED

306 NORTH FIFTH STREET, PERKASIE, PA
(215) 257-5711

DSN BY:	P.C.A.
CHK BY:	P.C.A.
DATE:	4/08/96
DWG NO.	PRA-W09